

POWER CONTROL OF PERMANENT MAGNET SYNCHRONOUS GENERATOR BASED VARIABLE SPEED WIND TURBINE

¹ AMI M TRIVEDI

¹ Department Of Electrical Engineering,
Shantilal Shah Engineering College,
Bhavnagar, Gujarat, India.

ami123_pam@yahoo.co.in

ABSTRACT : This paper describes the operation and control of one of these variable-speed wind generators : the direct driven permanent magnet synchronous generator (PMSG). This generator is connected to the grid by means of an IGBT rectifier, a DC bus, an IGBT inverter and a filter. The modelling of the converters is made by using the concept of instantaneous average value. We have used an aleatory profile of wind speed in order to illustrate the different controls realized, especially with maximum power point tracking algorithm (MPPT) and Pitch control at wind turbine level. To control the voltage of the continuous bus and the exchanges of active and reactive powers, we have used proportional integral correctors. The simulation results under Matlab\Simulink obtained and commented in order to validate the control strategy adopted.

Keywords - Wind energy, Variable-speed wind turbine, MPPT, Pitch control, PMSG, Control, Grid.

1. INTRODUCTION

In recent years, the production of electricity from renewable energy sources like wind energy increases due to environmental problems and the shortage of traditional energy sources in the near future [1].

Because of the rapid development of power electronic devices and thus decreasing equipment costs, the variable speed wind turbine concept with full-scale frequency converter has an increasing market share. The most common generators used in this topology, the doubly fed induction generators (DFIGs) and permanent magnet synchronous generators (PMSGs), allow the extraction of maximum power from a large wind speed interval. [3].

the control of a variable-speed permanent-magnet generator with a diode-rectifier followed by a dc chopper is shown. With this configuration the control of the generator power factor is not possible, which in turn, affects generator efficiency. Also, high harmonic distortion currents are obtained in the generator that reduce efficiency and produce torque oscillations.

This paper describes the modelling and control system of a direct-drive variable-speed permanent-magnet generator with an IGBT-rectifier, connected to the grid. The presented topology is subjected to a number of control schemes : Pitch angle control for limiting the output power above rated values, MPPT (Maximum Power Point Tracking) control for extracting of the maximum power and grid side inverter control for active, reactive power flow control, and constant DC bus control.

The proposed global model can easily be simulated with the help a software like Matlab- SIMULINK.

Simulations are carried out by considering a 750 kW wind generator.

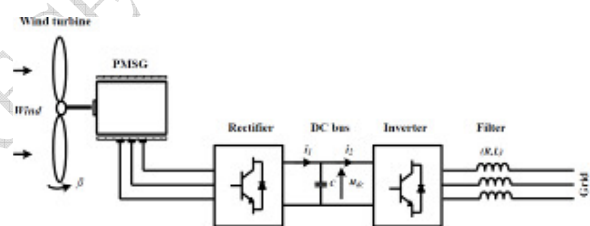


Fig. 1. Configuration of a PMSG wind turbine

I. MODEL REQUIREMENTS

The variable speed wind turbine, including the mechanical components, the direct drive permanent magnet synchronous generator and so on, is a complex electromechanical system.

A. AERODYNAMIC MODEL

The aerodynamic power at the rotor of the turbine is given by the following equation :

$$P_t = \frac{1}{2} \rho \pi R_t^2 v^3 C_p(\lambda, \beta) \quad \text{- Eq. 1}$$

where ρ (kg.m-3) is the air density, R_t (m) is the turbine radius, v (m.s-1) is the wind speed and $C_p(\lambda, \beta)$ is the power coefficient which represents the aerodynamic efficiency of the turbine and also depends on speed ratio λ and the pitch angle β . The speed ratio λ , is given by :

$$\lambda = \frac{R_t \Omega_r}{v} \quad \text{- Eq. 2}$$

Ω_t is the mechanical turbine speed (rad/s). The mechanical torque produced by the turbine is expressed as follows [4] :

$$C_t = \frac{1}{2} \rho \pi R_e^3 v^2 C_m(\lambda, \beta) \quad \text{- Eq. 3}$$

$C_m(\lambda, \beta)$ is the torque coefficient :

$$C_m(\lambda, \beta) = \frac{C_p(\lambda, \beta)}{\lambda} \quad \text{- Eq.4}$$

For different values of β , the $C_p(\lambda, \beta)$ curves are shown in Fig.2

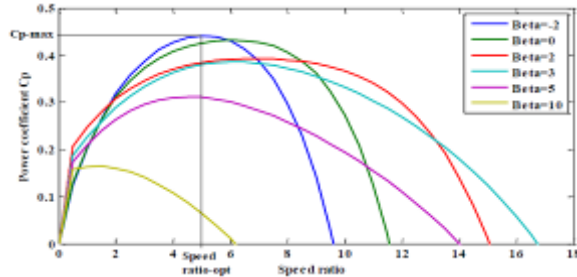


Fig. 2. Power coefficient characteristic versus speed ratio λ and pitch angle β

We note the existence of the maximal value of power coefficient C_{pmax} corresponding to the optimal value of the speed ratio $\lambda_{optimal}$ for each value of pitch angle β . The maximum value of C_p , that is $C_{pmax}=0.44$, is achieved for $\beta=-2^\circ$ and for $\lambda=5$. This particular value λ_{opt} results in the point of optimal efficiency where the maximum power is captured from wind by the wind turbine.

B. MECHANICAL DRIVE TRAIN

In a comparative study of wind turbine generator system using different drive train models. The evolution of the mechanical speed of the synchronous generator can be easily determined using the dynamic equation. The simplified model of this equation is given by:

$$J_T \frac{d\Omega_t}{dt} = C_t - C_{em} - f \Omega_t - C_s \quad \text{- Eq. 5}$$

where J_T (kg.m²) is the total inertia which appears on the shaft of the generator, Ω_t (rad/s) is the turbine speed, C_t (N.m) is the mechanical torque, C_{em} (N.m) is the electromagnetic torque, C_s (N.m) is the dry friction torque and f (N.m.s.rad-1) is a viscous friction coefficient.

C. PITCH ANGLE CONTROL

The pitch angle control system is primarily used to limit the aerodynamic power above rated wind speed in order to keep the turbines' speed constant without over speed in Figure. The inertia of the MW-level wind turbines' blades turned by the drive is large and the pitch actuator angle cannot change immediately, but only at a finite rate. The maximum rate of change of the pitch angle is in the order from 3 to 10 degree per second, depending on the size of the wind turbine.

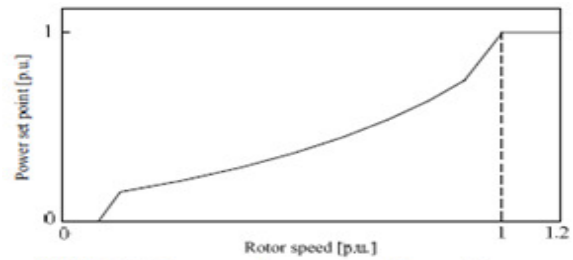


Fig 3 Optimal rotor speed versus power characteristic

For variable-speed wind turbines, a mechanical actuator is usually employed to change the pitch angle of the blades in order to reduce power coefficient C_p and maintain the power at its rated value. This speed actuator is an actuator proportional presenting a not – linearity. The torque has been supposed proportional to rotational speed of the turbine by linearization of the model to order 1 [4-5]. The control strategy implemented is as follows :

$$\begin{cases} \beta_{ref} = \beta_0 = -2 & \text{for } 0 < \Omega_t \leq \Omega_{tn} \\ \beta_{ref} = \frac{\Delta\beta}{\Delta\Omega} (\Omega_t - \Omega_{tn}) + \beta_0 & \text{for } \Omega_t > \Omega_{tn} \end{cases} \quad \text{- Eq. 6}$$

with β_0 ($^\circ$) is the initial pitch angle (optimal value) and Ω_{tn} (rad/s) is the Nominal mechanical turbine speed. After, to take into account the orientation system of the blades which can be of type hydraulic or electric, we introduce a transfer function of the first order. The purpose of this system is to control the position of the blades according to a reference.

$$\beta = \frac{1}{1 + \tau_b s} \beta_{ref} \quad \text{- Eq. 7}$$

s is the Laplace operator and τ_b is the time-constant of the orientation system of the blades. Below Figure shows the block diagram of the Pitch angle control system implanted in the simulation software Matlab-Simulink.

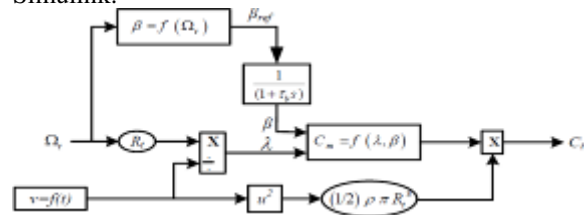


Fig:4 Scheme of the implemented pitch control method

D. PERMANENT-MAGNETIC SYNCHRONOUS GENERATOR (PMSG)

i. MODELLING

The model generally used of the PMSG is the Park model. By considering only the fundamental harmonic of the flux distribution in the air-gap of the machine and by neglecting the homopolar

component, the theory of the space vector gives the dynamic equations of the stator currents as follows :

$$\begin{cases} \frac{di_{sd}}{dt} = \frac{1}{L_s} (v_{sd} - R_s i_{sd} + L_s p \Omega_s i_{sq}) \\ \frac{di_{sq}}{dt} = \frac{1}{L_s} (v_{sq} - R_s i_{sq} - L_s p \Omega_s i_{sd} - p \Omega_s \phi_o) \end{cases} \text{ - Eq. 8}$$

where R_s is the phase resistance of the stator winding (Ω), L_s is the stator cyclic inductance (H), Φ_a is the flux of the permanent magnetic (Wb), v_{sd} and v_{sq} are the d-q components of the stator voltages respectively (V), i_{sd} and i_{sq} are the d-q components of the stator currents respectively (A), and p is the number of pairs of poles. The electromagnetic torque is given by :

$$C_{em} = p \phi_a i_{sq} \text{ - Eq. 9}$$

ii. CONTROL

In a variable-speed wind turbine, maximum power is a cubic function of rotational speed. To maximize efficiency, losses for a given load must be minimized. A stator q-axis current component is used to develop generator torque, but a freedom degree remains to set direct current. A direct-axis current component can be set at zero to minimize current for a given torque, and therefore, minimize resistive losses. Thus, the generator torque may be controlled directly by the quadrature current component. Figure shows the schematic diagram of the control loops of the permanent-magnet generator-side converter. The required d-q components of the rectifier voltage vector are derived from two proportional plus integral (PI) current controllers: one of them controlling the d-axis component of the current and the other one the q-axis component. Compensation terms are added to improve the dynamic response. The control requires the measurement of the stator currents, dc voltage, and rotor position. Pulse Width Modulation (PWM) is used to generate the switching signals for the power converter semiconductors.

• CONTROL STRATEGY 1:

The first method for an operating at maximum power, aims at improving the aerodynamic output of the turbine in order to extract the wind power maximum. This power is extracted when the turbine operates at maximum power coefficient.

Equation 1 gives the expression of the maximum power obtained using the strategy MPPT (Maximum Power Point Tracking), which permit to adjust automatically the ratio speed at its optimum value λ_{opt} , in order to obtain the maximum power coefficient C_{pmax} (Fig. 2). This equation shows the relationship between turbine power and turbine speed at maximum power. When regulating the system under the specification of maximum power, it must be taken into account that turbine power must never be higher than generator rated power. Once generator

rated power is reached at rated wind speed, output power must be limited.

$$P_{MPPT} = \frac{\rho \pi R_e^5 C_{pmax} \Omega^3}{2 \lambda_{opt}^3} = K \Omega^3 \text{ - Eq. 10}$$

$$C_{em-ref} = \frac{P_{MPPT}}{\Omega} = K \Omega^2 \text{ - Eq. 11}$$

• CONTROL STRATEGY 2:

The second method for a nominal operating of the wind generator, is used to maintain the generator power at its rated value in the case of high winds. This operating mode is obtained with the pitch angle control. The control structure of the wind generator is given in Fig. 5.

E. MODELING OF POWER CONVERTERS

The power converter consists of two back-to-back insulated gate bipolar transistors (IGBTs) bridges; the one connected to the generator works as a pulse rectifier; the other one, connected to the grid. The modeling of the converters is made by using the concept of instantaneous average value. Indeed, this type of modeling is interesting since it adapts well to a numerical integration so it is not necessary to choose a step of integration lower than the period of operation of the converters.

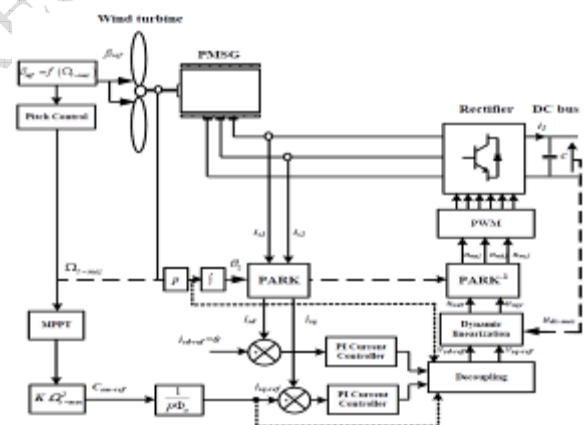


Fig: 5 Control Structure of the wind generator

Moreover, it makes it possible to simulate the total dynamic behaviour of the system. Thus, in the model of Park, the modulated tensions (AC side) by the two converters are connected to the the DC bus voltage u_{dc} by :

$$\begin{cases} \begin{pmatrix} v_{sd} \\ v_{sq} \end{pmatrix} = \frac{u_{dc}}{2} \begin{pmatrix} u_{wd1} \\ u_{wq1} \end{pmatrix} \\ \begin{pmatrix} v_{od} \\ v_{oq} \end{pmatrix} = \frac{u_{dc}}{2} \begin{pmatrix} u_{wd2} \\ u_{wq2} \end{pmatrix} \end{cases} \text{ - Eq. 12}$$

with $\begin{bmatrix} u_{wd1} & u_{wq1} \end{bmatrix}$ and $\begin{bmatrix} u_{wd2} & u_{wq2} \end{bmatrix}$ are respectively the Park components of the reference

voltages of rectifier and inverter. v_{od} and voq are the Park components of the modulated voltages at the output of inverter. By neglecting the losses in the converters, the equality of the average power DC side with the active power AC side for each converter gives :

$$\begin{cases} i_1 = \frac{1}{2}(i_{sd}u_{sd1} + i_{sq}u_{sq1}) \\ i_2 = \frac{1}{2}(i_{sd}u_{sd2} + i_{sq}u_{sq2}) \end{cases} \text{ - Eq. 13}$$

i_{rd} and i_{rq} are the Park components of the modulated currents at the output of inverter.

F. CONTROL OF THE POWERS EXCHANGED WITH THE AC GRID

The provided energy by the PMSG-based variable-speed wind turbine and transmitted on DC current is applied to an inverter which makes it possible to control the continuous voltage and the active and reactive powers exchanged with the grid characterized by a voltage v_r and frequency $f = 50$ Hz . An inductive filter has been designed to limit harmonic current injection into the grid. The dynamic model of the grid connection when selecting a reference frame rotating synchronously with the grid voltage space vector is:

$$\begin{cases} v_{sd} = v_{sd} - Ri_{sd} - L \frac{di_{sd}}{dt} + L\omega_r i_{sq} \\ v_{sq} = v_{sq} - Ri_{sq} - L \frac{di_{sq}}{dt} - L\omega_r i_{sd} \end{cases} \text{ -Eq. 14}$$

where L and R are respectively the grid inductance and resistance, and ω_r is the grid frequency. The active and reactive powers delivered to grid can be expressed as :

$$\begin{cases} P_r = v_{sd} i_{sd} + v_{sq} i_{sq} \\ Q_r = v_{sq} i_{sd} - v_{sd} i_{sq} \end{cases} \text{ -Eq. 15}$$

Because the d-axis of the reference frame is oriented along the grid voltage, the grid voltage vector is :

$$v_r = v_{sd} + j0 \text{ - Eq.16}$$

Thus, the active and reactive powers can be expressed as :

$$\begin{cases} P_r = v_{sd} i_{sd} \\ Q_r = -v_{sd} i_{sq} \end{cases} \text{ - Eq. 17}$$

Active and reactive power control can be achieved by controlling direct and quadrature current components, respectively. The control of this converter (inverter) is quite similar to that of the generator. Two control loops are used to control the active and reactive power, respectively.

G. DC BUS MODELING AND CONTROL

From First Figure, the evolution of the DC voltage can be deduced :

$$\frac{du_{dc}}{dt} = \frac{1}{C} (i_1 - i_2) \text{ Eq. 18}$$

Classically, the active power reference value is determined by the continuous voltage controller. This power reference depends in fact on the active power consumed or generated by the wind generator which can be estimated from as follows :

$$P_{w-ref} = u_{dc-ref} i_1 \text{ - Eq. 19}$$

u_{dc-ref} is the DC voltage reference value. Fig 6 shows the continuous voltage control and the ce value determination taking into account above. The DC voltage control compensates the Converter losses which are neglected in above.

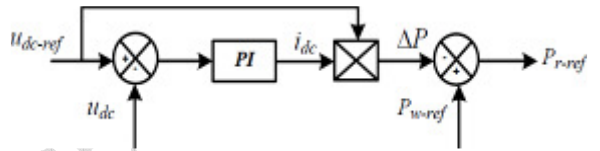


Fig:6 DC voltage control and active power reference value generation

An outer dc voltage control loop is used to set the d-axis current reference for active power control. This assures that all the power coming from the rectifier is instantaneously transferred to the grid by the inverter. The second channel controls the reactive power by setting a q-axis current reference to a current control loop similar to the previous one. We impose zero reactive power as reference ($Q_r-ref = 0$) in the system control, to ensure unitary power factor operation. The current controllers will provide a voltage reference for the inverter that is compensated by adding compensation terms. All controllers are PI.

The control scheme of inverter is presented in below Figure:7

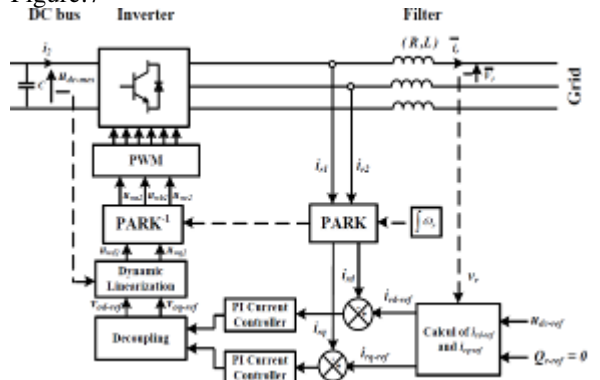


Fig 7 Control scheme of inverter

H. SIMULATION PROCESS AND RESULTS:

In this section, to show the principle of power control of PMSG-based variable-speed wind turbine connected to the grid, it is controlled in order to capture the maximum wind energy and its behavior subjected to a variable speed wind will be illustrated using numerical simulations carried under the Matlab - SIMULINK. The wind speed varies according to the profile in below Figure.

We will show the PMSG speed N_t (rpm), the pitch angles β_{ref} and β , the power coefficient C_p , the electromagnetic torques C_{em-ref} and C_{em} , the wind power P_w , the DC bus voltage u_{dc} , the active powers P_r and P_{r-ref} , the reactive powers Q_r and Q_{r-ref} , and the grid currents i_{rabc}

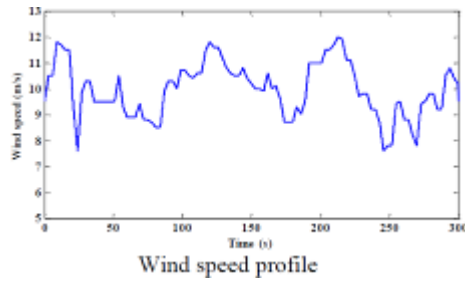


Fig:8

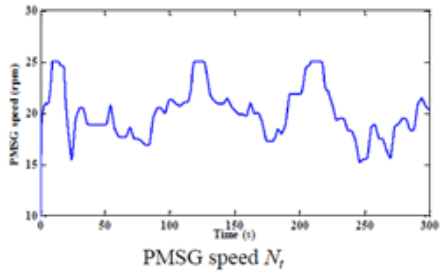


Fig:9

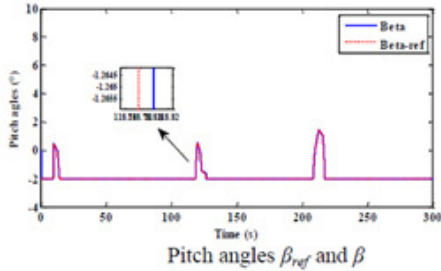


Fig 10

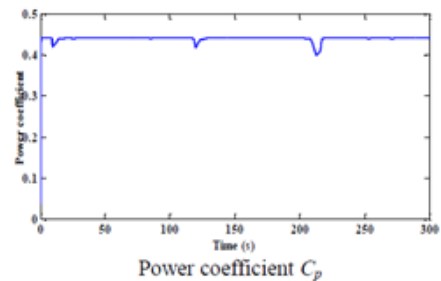


Fig:11

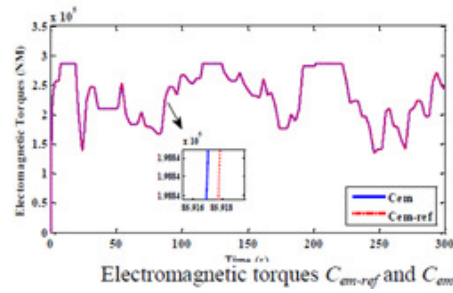


Fig:12

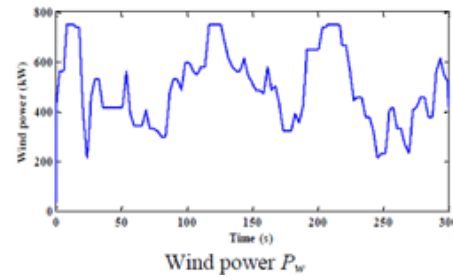


Fig:13

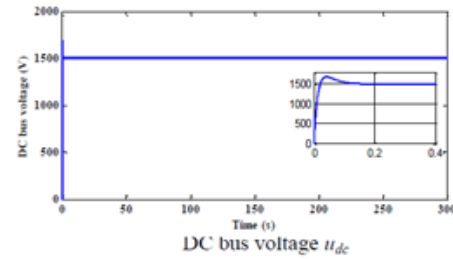


Fig:14

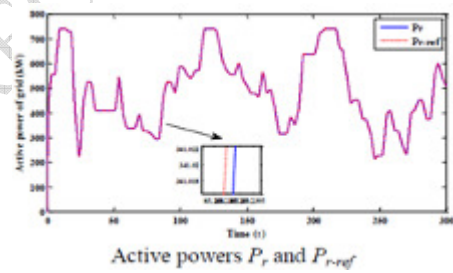


Fig:15

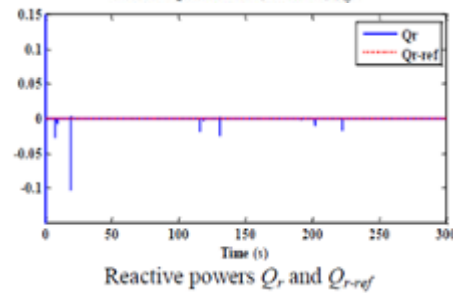


Fig:16

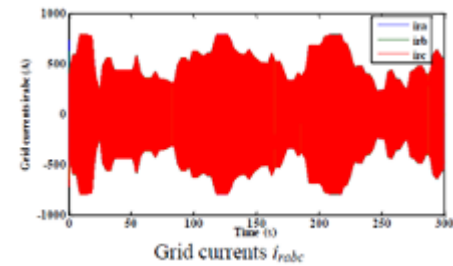


Fig:17

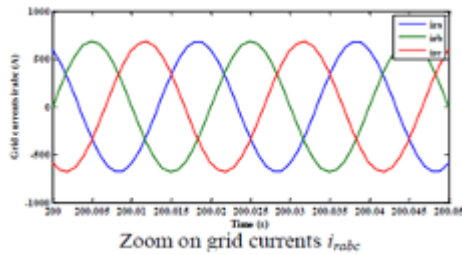


Fig:18

The wind generator is controlled in order to capture the maximum wind energy. When rotational speed is low than the nominal value (25 rpm) (Fig 9), the conversion system operate under MPPT control. But when the wind speed exceeds the nominal value, the Pitch angle increases to reduce the turbine torque (Fig 10) and the power coefficient decreases (Fig 11). with keeping constants rotational speed and power generated. Fig 10 shows also that the Pitch angle follows well its reference. Consequently, we prove the efficiency of the implanted actuator.

It is easy to check that the PMSG speed (Fig 9), the electromagnetic torque (Fig 12) and the wind power (Fig 13) are deeply correlated with the wind speed. The wind power is optimized with MPPT strategy and keeps at his nominal value when the turbine speed exceeds the nominal value (Fig 13). The DC bus voltage is represented in Fig 14 which demonstrates that this voltage is perfectly constant equal to 1500 V and thus proves the effectiveness of the established regulators. The Fig 15 shows the active power of grid which is substantially equal, except for the losses, to the generated power by wind source. The reactive power reference value is maintained equal to zero (Fig 16). Then, we operate with unitary power factor. The injected currents to the grid are represented in Fig 17 and 18. It is easy to prove that they are three sinusoidal currents with constant frequency equal to 50 Hz, and variable amplitude according to the wind speed variation.

CONCLUSION

The main focus of this paper has been the study and control of a direct-driven PMSG used in variable speed wind-energy system connected to the grid. This wind system was modelled using d-q rotor reference frame and is interfaced with the power system through an inverter and a filter modeled in the power system reference frame. The control strategy developed insured power optimization with conventional MPPT strategy and limitation over the rated turbine speed by Pitch angle control. The inverter control allowed, through grid current regulation, to achieve a decoupled active and reactive power control for operate with unitary power factor.

The proposed global model was simulated with the help a software like Matlab-Simulink. The simulation results showed the effectiveness of the control strategy adopted.

APPENDIX

WIND TURBINE

Radius: $R_e = 24$ m
 Number of blades : 3
 Nominal rotational speed : $N_{tn} = 25$ rpm
 $\lambda_{optimal} = 5$
 $C_{pmax} = 0.44$
 Density of air : $\rho = 1.22$ kg.m⁻³
 Dry friction torque : $C_s = 953$ Nm
 Viscous friction coefficient : $f = 0$ N.m.s.rad⁻¹
 Total inertia of the mechanical transmission :
 $JT = 105$ kg.m²

PMSG

Nominal power : $P_n = 750$ kW Nominal speed of the turbine : $N_{tn} = 25$ rpm Stator resistance : $R_s = 0.01\Omega$
 Self-inductance : $L_s = 7.79$ mH Permanent magnetic flux : $\Phi_a = 7.3509$ Nm/A Number of pole pairs : $p = 42$
 DC bus and filter
 DC bus voltage : $u_{dc} = 1500$ V
 Equivalent capacitance: $C = 10$ mF
 Filter resistance : $R = 0.01\Omega$
 Filter inductance : $L = 1$ mH

REFERENCES

- [1]. H. Erich, Wind turbines: Fundamentals, Technologies, Application, Economics, 2nd Edition, 2005.
- [2]. M. Stiebler, Wind Energy Systems for Electric Power Generation, 2008.
- [3]. Cristian Busca, Ana-Irina Stan, Tiberiu Stanciu and Daniel Ioan Stroe, "Control of Permanent Magnet Synchronous Generator for Large Wind Turbines" IEEE International Symposium on Industrial Electronics, (ISIE 2010) July 04-07, 2010, Bari, Italy.
- [4]. Leclercq Ludovic, « Apport du stockage inertiel associé à des éoliennes dans un réseau électrique en vue d'assurer des services systèmes ». Thèse de Doctorat : Génie Electrique : Université des Sciences et Technologies de Lille, Villeneuve d'Asq, 2004, 171 p, n°3563.
- [5]. J. L. Rodriguez – Amenedo, S. Arnalte et J. C. Burgos, « Automatic generation control of wind farm with variable speed wind turbine », IEEE Transactions on Energy Conversion, Vol. 17, 2002, n°2
- [6]. W. Leonhard, Control of Electrical Drives. New York: Springer, 1997.